




ASPHALT OVERLAYED PCC STREETS
DETAIL 135.1

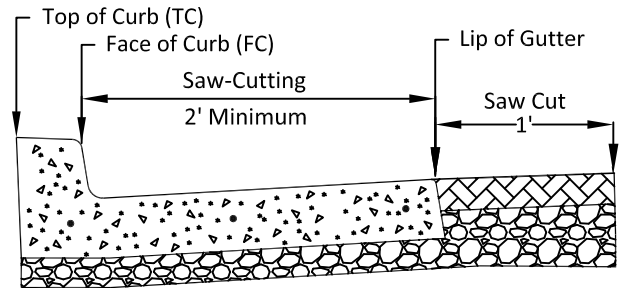

ASPHALT STREETS W/EXPOSED GUTTERS
DETAIL 135.2

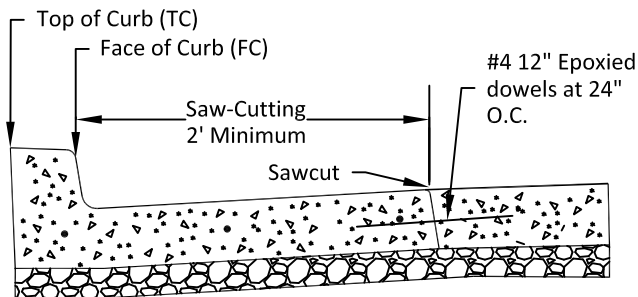

MONOLITHIC PCC STREETS
DETAIL 135.3

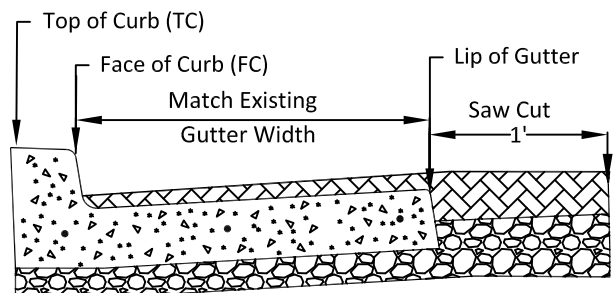

ASPHALT STREETS W/OVERLAYED GUTTERS
DETAIL 135.4

NOTES 135.1

- A. Saw-cut 2 ft. from the face of curb.
- B. If a lip of gutter is present, saw-cut PCC slab equidistant for the length of curb being replaced.

NOTES 135.2

- A. Replacing curbs with an expose gutter, the asphalt shall be saw-cut 1 ft. from lip of gutter.

NOTES 135.3

- A. When replacing curbs on PCC streets, where the slab is monolithic with the curb and gutter, saw-cut 2 ft. from the face of curb, creating a lip of gutter that matches the existing PCC thickness.


NOTES 135.4

- A. Replacing curbs with NO exposed gutter, the asphalt shall be removed to verify width of existing gutter pan an saw-cut 1 ft. from the unexposed lip of gutter.

Rev	By	Date
1	MN	10/25/04
2	JT	08/14/06
3	HQN	10/03/06
4	RTN	06/10/17
Scale: NTS		

Vertical Curb and Gutter
Type A
Saw-Cutting Detail

City of Palo Alto Standard

Approved by:	
PE No.	72158
Date	01/10/18
Dwg No.	135