




ASPHALT OVERLAYED PCC STREETS
DETAIL 136.1

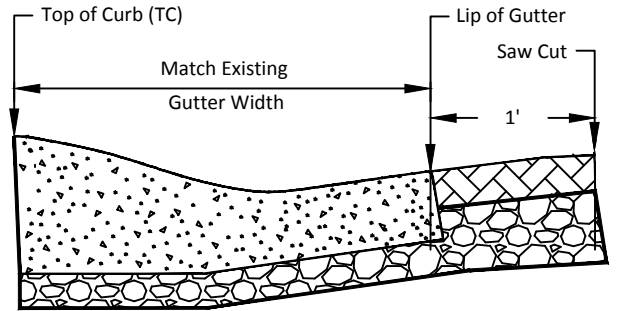

ASPHALT STREETS W/EXPOSED GUTTER
DETAIL 136.2

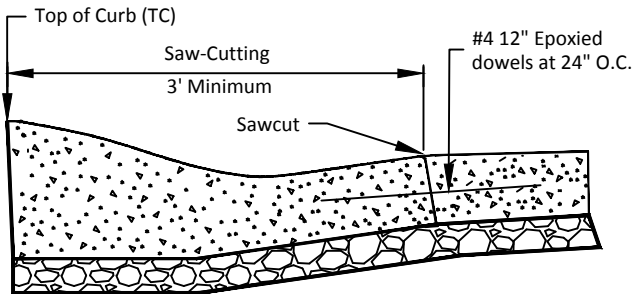

MONOLITHIC PCC STREETS
DETAIL 136.3

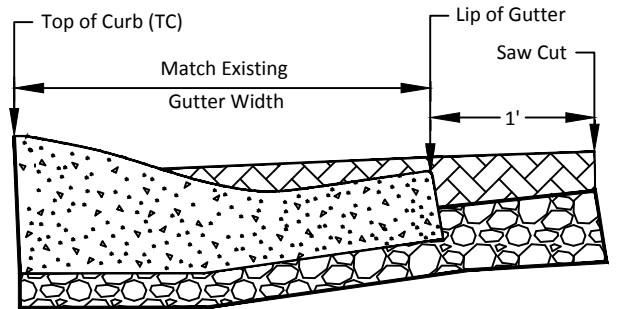

ASPHALT STREET WITH NO EXPOSED GUTTER
DETAIL 136.4

NOTES 136.1

- A. Saw-cut 3 ft. from top of curb.
- B. If a lip of gutter is present, then saw-cut PCC slab at that distance for the length of curb being replaced.

NOTES 136.2

- A. Replacing curbs with an exposed gutter, the asphalt shall be saw-cut 1 ft. from lip of gutter for placement of forms.

NOTES 136.3

- A. When replacing curbs on PCC streets, where the slab is monolithic with the curb and gutter saw-cut 3' from the top of curb, creating a lip of gutter that matches the existing PCC thickness and elevations.


NOTES 136.4

- A. Replacing curbs with NO exposed gutter, the asphalt shall be removed to verify the width of the underlying gutter pan and to expose any lip of gutter that exists.
- B. The saw-cut shall be made 1 ft. from the exposed lip of gutter into the street for placement of forms.

Rev	By	Date
1	MMN	10/25/04
2	JT	08/14/06
4	HQN	10/03/06
3	RTN	06/10/17
Scale: NTS		

Rolled Curb and Gutter
Type B
Saw Cutting Detail

City of Palo Alto Standard

Approved by: 

PE No. 72158
Date 01/10/18

Dwg No. 136