


TYPICAL CITY BLOCK PLAN

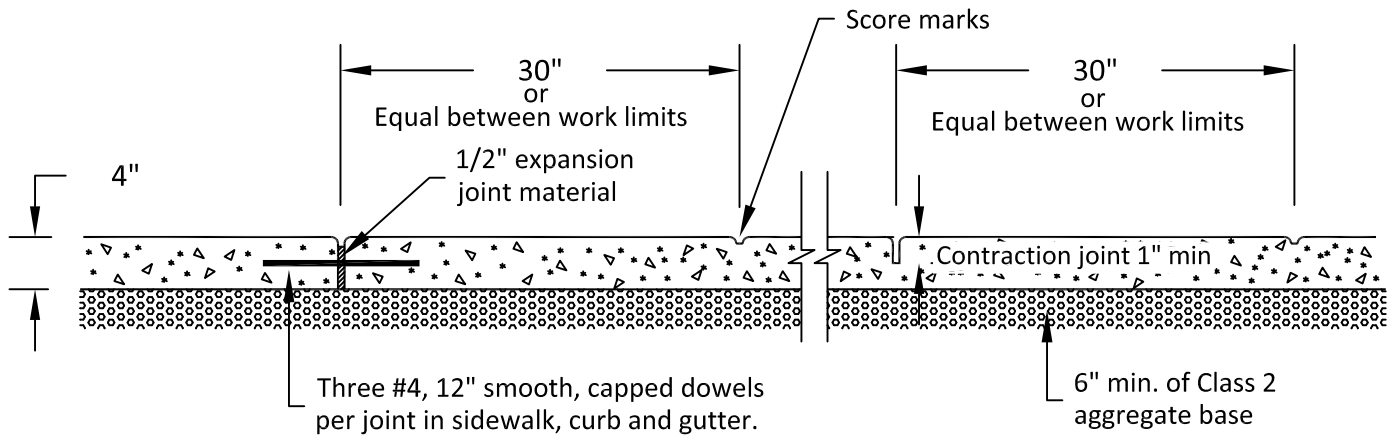

Expansion joint

Contraction joint

LONGITUDINAL SECTIONS

NOTES:

1. Sidewalks to be marked in 30" squares.
2. Edges to have a 3/4" radius.
3. Score marks shall be minimum 3/8" deep; contraction joints shall be 1" minimum depth at 10 ft. O.C.
4. Contraction joints may be saw-cut.
5. Sidewalks to have 1.5% slope to street.
6. All new sidewalk shall be doweled at 2 ft. O.C. into existing concrete with #4, 12" long dowels and embedded 6".
7. Saw-cut walk full depth and full width on score marks perpendicular to the curb. No saw-cutting on longitudinal score marks.
8. Install longitudinal deep score along entire back of curb that is monolithic with the sidewalk.

Rev	By	Date
0	DWH	12/14/92
1	MN	01/29/02
2	HQN	01/04/07
3	RTN	08/10/17

Scale: NTS

Sidewalk Construction

City of Palo Alto Standard

Approved by:	
PE No.	72158
Date	01/10/18
Dwg No.	141