


SIDE VIEW FRONT VIEW

CLEARANCE REQUIRED
AROUND WINDOWS

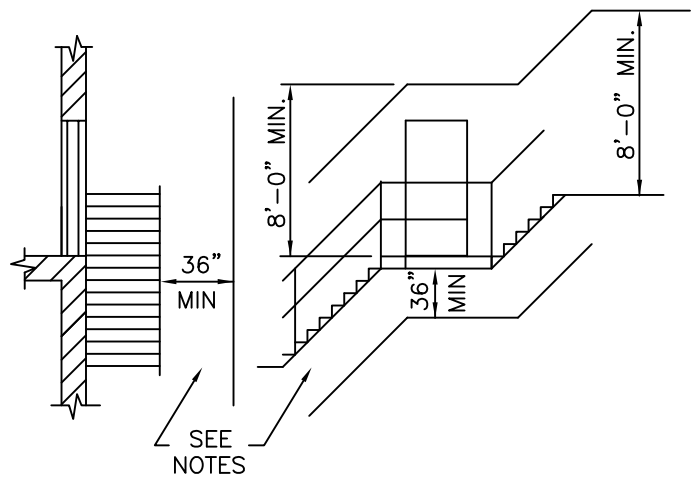

SIDE VIEW FRONT VIEW

CLEARANCE REQUIRED
AROUND DOORS

LEGEND:

———— BOUNDARY OF CLEARANCE AREA THROUGH WHICH CONDUCTORS MUST NOT PASS.

NOTES:

1. SERVICE WIRES SHOULD NOT BE ATTACHED TO THE BUILDING WALL WITHIN THE ABOVE CLEARANCE AREA AND SHOULD NOT PASS THROUGH CLEARANCE SPACE ILLUSTRATED IN SKETCHES.
2. GENERAL ORDER 95, ISSUED BY THE CALIFORNIA PUBLIC UTILITIES COMMISSION REQUIRES THAT:
 - A. ALL PORTIONS OF THE SERVICE DROP SHALL HAVE A MINIMUM HORIZONTAL CLEARANCE OF 3 FEET FROM ANY EXIT, WINDOW, OR OTHER POINT AT WHICH HUMAN CONTACT MIGHT BE EXPECTED.
 - B. THE SERVICE DROP SHALL BE LOCATED TO MINIMIZE INTERFERENCE WITH OR ENDANGERING WORKMEN AND FIREMEN IN THE PERFORMANCE OF THEIR DUTIES. THIS MEANS THAT SERVICE DROPS SHALL BE LOCATED SO THAT A FIREMAN CAN PLACE A LADDER AGAINST ANY WINDOW WITHOUT INTERFERENCE OR DANGER.

APPROVED <u>3/1994</u> <i>MD Burtel</i> ENGR. MANAGER		ENGINEERING STANDARD SERVICE DROP CLEARANCE REQUIREMENTS FOR WINDOWS, DOORS, FIRE ESCAPES, STAIRWAYS, BALCONIES, ETC.		2	8-08	REVISED NOTES	TT
ENGR	PEV	CITY OF PALO ALTO CALIFORNIA		1	9-99	CHANGED NOTES	FINCH
DRAWN	UES/MJ MJ			REV	DATE	DESCRIPTION	APPR
CHECKED	PEV			NTS	SCALE	SR-CL-0-1011	STANDARD NO.
							SHEET NO.