


TOP VIEW

NO OBSTRUCTIONS ALLOWED IN SHADED AREA.

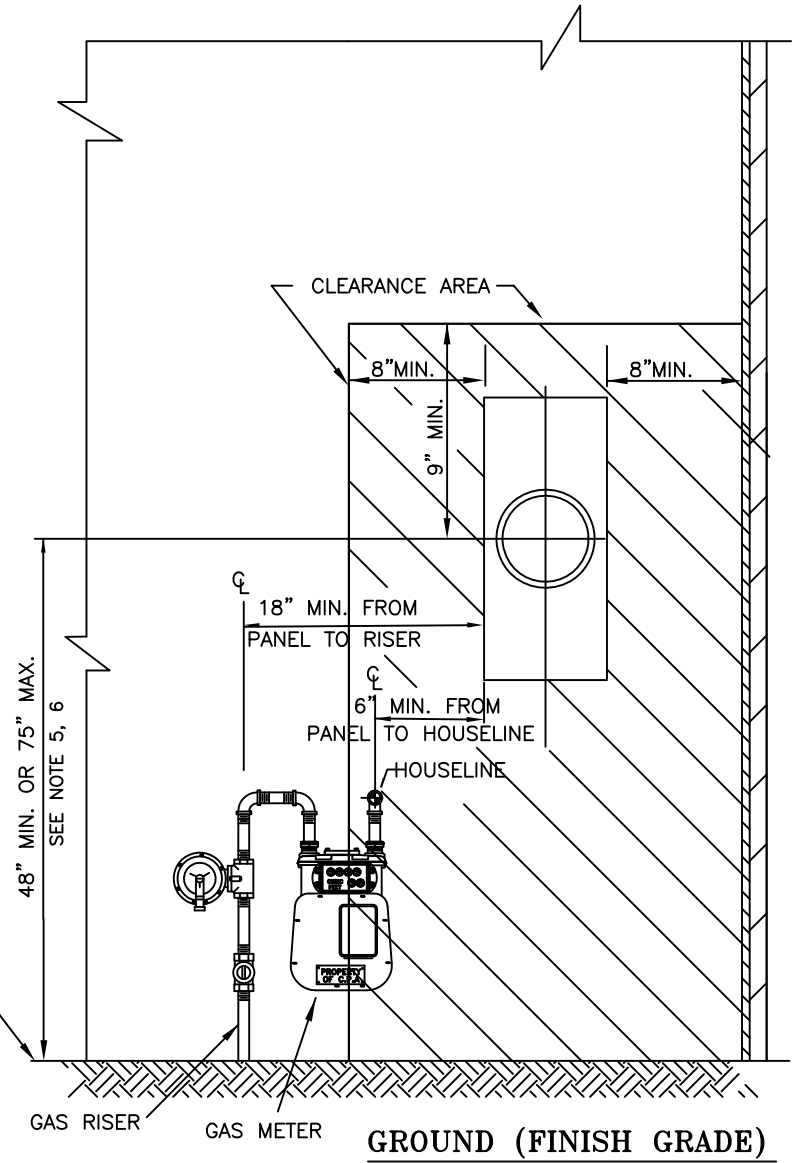

GROUND (FINISH GRADE)

NOTES:

1. THERE MUST BE AN 8 INCH MINIMUM CLEARANCE BETWEEN THE NEAREST EDGE OF THE METER PANEL AND ANY OBSTRUCTION OR WINDOW.
2. SUITABLE WORKING SPACE, AT LEAST 30 INCHES WIDE X 36 INCHES DEEP, SHALL BE PROVIDED IN FRONT OF THE METER SOCKET TO ALLOW FOR INSTALLATION, TESTING AND READING.
3. METERS SHALL BE LOCATED SO THAT THEY WILL NOT BE DAMAGED BY A SWINGING WINDOW OR DOOR.
4. THE WALL SURFACES ON EITHER SIDE OF A DOOR, FOR A DISTANCE EQUAL TO THE WIDTH OF THE DOOR, IS UNACCEPTABLE AS A METER LOCATION.
5. PER CEC ARTICLE 404.8(A) THE HIGHEST POSITION OF THE BREAKER HANDLE MUST BE LESS THAN 79" ABOVE GRADE/FLOOR.
6. SEE CPAU ENG STD SR-MT-E-1035 FOR REQUIREMENTS ON METERS INSTALLED IN DRIVEWAYS.

7	3-16	REVISED NOTES	TT
6	6-14	ADDED GUARD POST NOTE	TT
5	7-13	REVISED GAS METER	TT
4	1-11	REVISED CLEARANCES AND NOTES	TT
3	8-08	REVISED CLEARANCES AND NOTES	JT
2	6-06	REVISED CLEARANCES	TF
REV	DATE	DESCRIPTION	APPR

APPROVED 3/1994

 ENGR. MANAGER

ENGINEERING STANDARD
**REQUIRED MINIMUM CLEARANCES OF
 METER SOCKET FROM OBSTRUCTIONS**

ENGR	PEV	
DRAWN	UES/MJ	
CHECKED	PEV	

**CITY OF PALO ALTO
 CALIFORNIA**

NTS	SR-MT-E-1012	1 OF 1
SCALE	STANDARD NO.	SHEET NO.