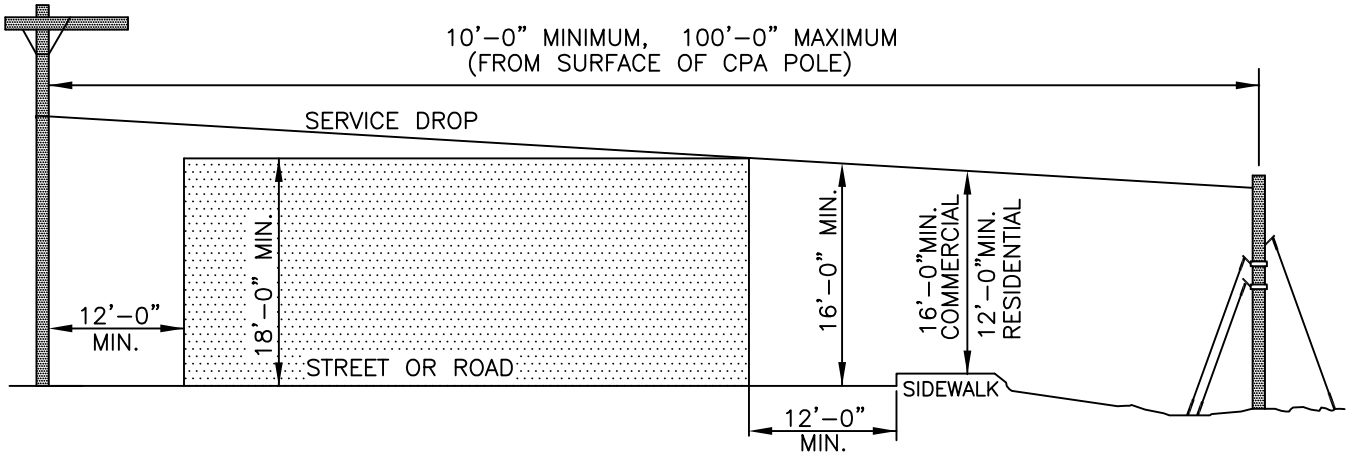

APPROVED 3/1994	ENGINEERING STANDARD					
	CLEARANCE FOR SERVICE POLE FOR SUPPLY SERVICE DROP 0–300 VOLTS	1	5/13	REVISED CLEARANCE BOX		TT
ENGR. MANAGER		REV	DATE	DESCRIPTION		APPR
ENGR PEV	CITY OF PALO ALTO CALIFORNIA	NTS		SR–CL–0–1017		1 OF 1
DRAWN MJ						
CHECKED PEV		SCALE		STANDARD NO.		SHEET NO.